

# Kidde Fire Systems Component Description




## Check Valves, 3-Inch (for use on 3" or 2 1/2" Pipe Diameter)

Effective: April 2023  
K-85-5120 Rev AD

### FEATURES

- For Approvals, see the "Compatibility" table on page 2.
- For use on 3" or 2 1/2" pipe diameter. Order two welding neck flanges to match pipe diameter for each 3" check valve.
- RoHS compliant

P/N: 81-870100-000

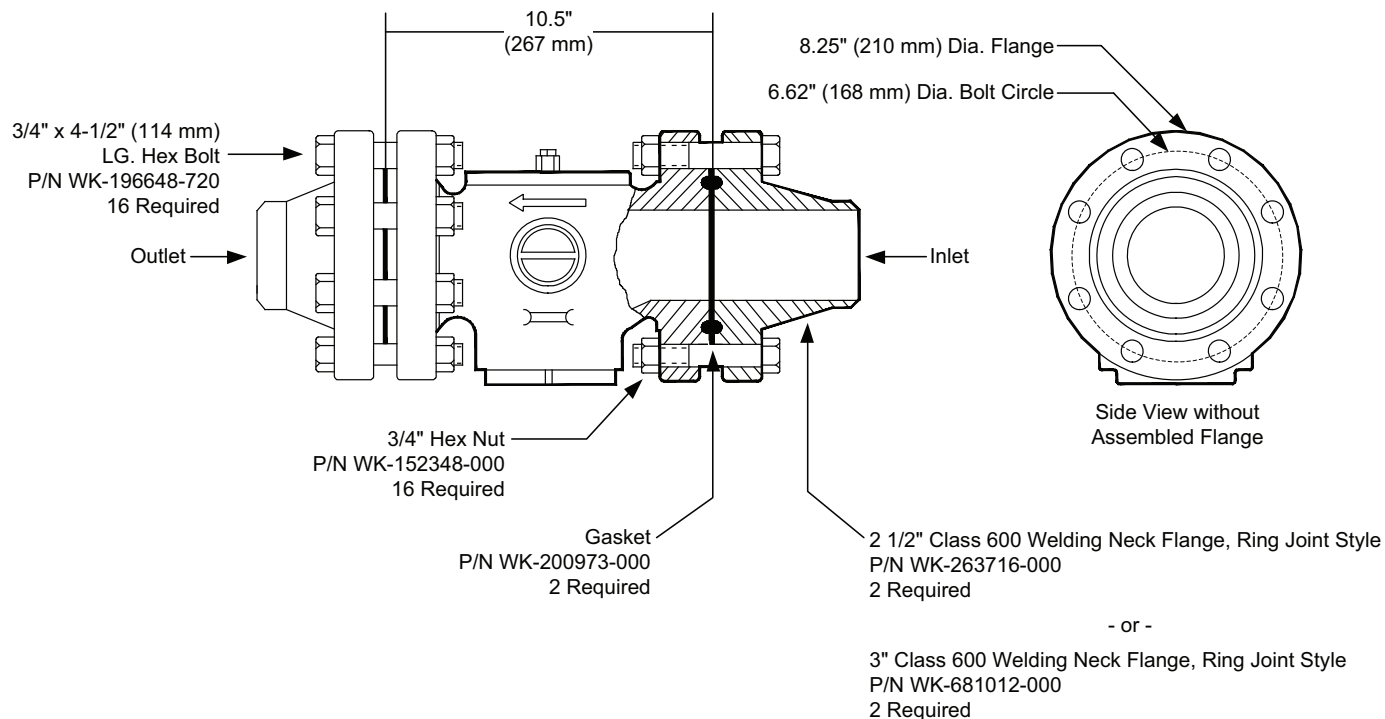

**Note:** Valve must be installed with the arrow pointing in the direction of flow.

### MATERIALS

Valve Body: Brass  
Gasket: Iron  
Flanges, Bolts and Nuts: Steel

### ORDER INFORMATION

Pipe Diameter	Welding Neck Flange P/N	Qty Required
2-1/2 in.	WK-263716-000	2
3 in.	WK-681012-000	2

## COMPATIBILITY

Series	DIOM P/N	Approvals
Kidde Fire Systems ECS-500™ System	06-237585-001	UL, ULC, FM
Kidde Fire Systems ECS-500™ Marine System	06-237589-001	UL, ULC, USCG
Kidde Fire Systems ADS™ for use with Fluoroketone Fire Suppression Agents	06-237256-001	UL, ULC, FM
Kidde Fire Systems ADS™ Marine for use with Fluoroketone Fire Suppression Agents	06-237257-001	UL, ULC, USCG
Kidde Fire Systems ADS™ with HFC-227ea Agent	06-236068-001	UL, ULC, FM
Kidde Fire Systems ADS™ Marine with HFC-227ea Agent	06-236595-001	UL, ULC, USCG
Kidde Fire Systems ECS™ 360 for use with Fluoroketone Fire Suppression Agents	06-236553-001	UL, ULC, FM
Kidde Fire Systems ECS™ 360 Marine for use with Fluoroketone Fire Suppression Agents	06-236559-001	UL, ULC, USCG
Kidde Fire Systems ECS™ 360 with HFC-227ea Agent	06-236115-001	UL, ULC, FM
Kidde Fire Systems Modular ECS™ 360 with HFC-227ea Agent	06-236116-001	UL, ULC, FM
Kidde Fire Systems ECS™ 360 Marine with HFC-227ea Agent	06-236225-001	UL, USCG
Kidde Fire Systems High Pressure CO <sub>2</sub> System	81-CO2MAN-001	UL, ULC, FM
Kidde Fire Systems High Pressure CO <sub>2</sub> Marine System	220610	UL, USCG

### EXPORT INFORMATION (USA)

Jurisdiction: EAR  
Classification: EAR99

This document contains technical data subject to the EAR.

All trademarks are the property of their respective owners.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. believes this data to be accurate, but it is published and presented without any guarantee or warranty whatsoever. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The fire suppression system design, installation, maintenance, service and troubleshooting must be performed by trained, authorized Kidde Fire Systems distributors for the product to work correctly. If you need more information on this product, or if you have a particular problem or question, contact: KIDDE-FENWAL, INC., Ashland, MA 01721 USA, Telephone: (508) 881-2000.