

Kidde Fire Systems ADS™ Cylinder Component Datasheet



200 lb. (81 L) Cylinder and Valve Assemblies with Fluoro-K™ Fire Suppression Clean Agent

Effective: November 2023
K-45-901 Rev AB

FEATURES

- Well Suited for Complicated Pipe Networks and Large Area Coverage with Minimal Room for Cylinder Storage
- 100 lb. to 200 lb. Fill Capacity
- Agent Cylinder Liquid Level Indicator
- Uses one Nitrogen Driver
- UL Listed, File Number 4674
- FM Approved
- For RoHS Compliance, See the Individual Component Datasheets

DESCRIPTION

Kidde Fire Systems Advanced Delivery Systems (ADS™ system) are Underwriters Laboratory (UL) listed and Factory Mutual (FM) approved. These systems are designed for total flooding in accordance with NFPA 2001, *Standard on Clean Agent Extinguishing Systems*. These systems have been tested to UL 2166, *Standard for Safety; Standard for Halocarbon Clean Agent Extinguishing System Units*, and Factory Mutual 5600, *Examination Standard for Clean Agent Extinguishing Systems*.

The ADS system uses a unique method for propelling the Fluoro-K™ Fire Suppression Clean Agent (herein referred to as "Agent") from the storage cylinder, through the piping system and out of the discharge nozzles. Nitrogen gas pressure from a separate storage cylinder is introduced into the vapor space of the Agent Cylinder at a controlled rate. This nitrogen pressure acts to propel the Agent through the pipe at a higher flow rate. It can also propel the agent farther through the pipe network allowing for the placement of storage cylinders remotely from the protected hazard.

The ADS system is extremely well-suited to applications involving remote agent storage and situations which limit the maximum pipe size to be used. The system is capable of using smaller pipe sizes to discharge large quantities of Agent.



OPERATION

When a control head actuates the nitrogen cylinder discharge valve, the nitrogen pressure actuates the agent cylinder discharge valve and pressurizes the cylinder. Agent is then propelled by its own vapor pressure and the nitrogen pressure through the discharge valve and into the system pipe network. The agent travels through the system pipe network at a high flow rate.

OPERATING RANGE LIMITATIONS

- The operating temperature range for all components used in the ADS system is 32° to 130°F (0° to 54°C)
- The agent cylinder operating temperature must be between 60° to 80°F (16° to 27°C) for unbalanced pipe network systems.

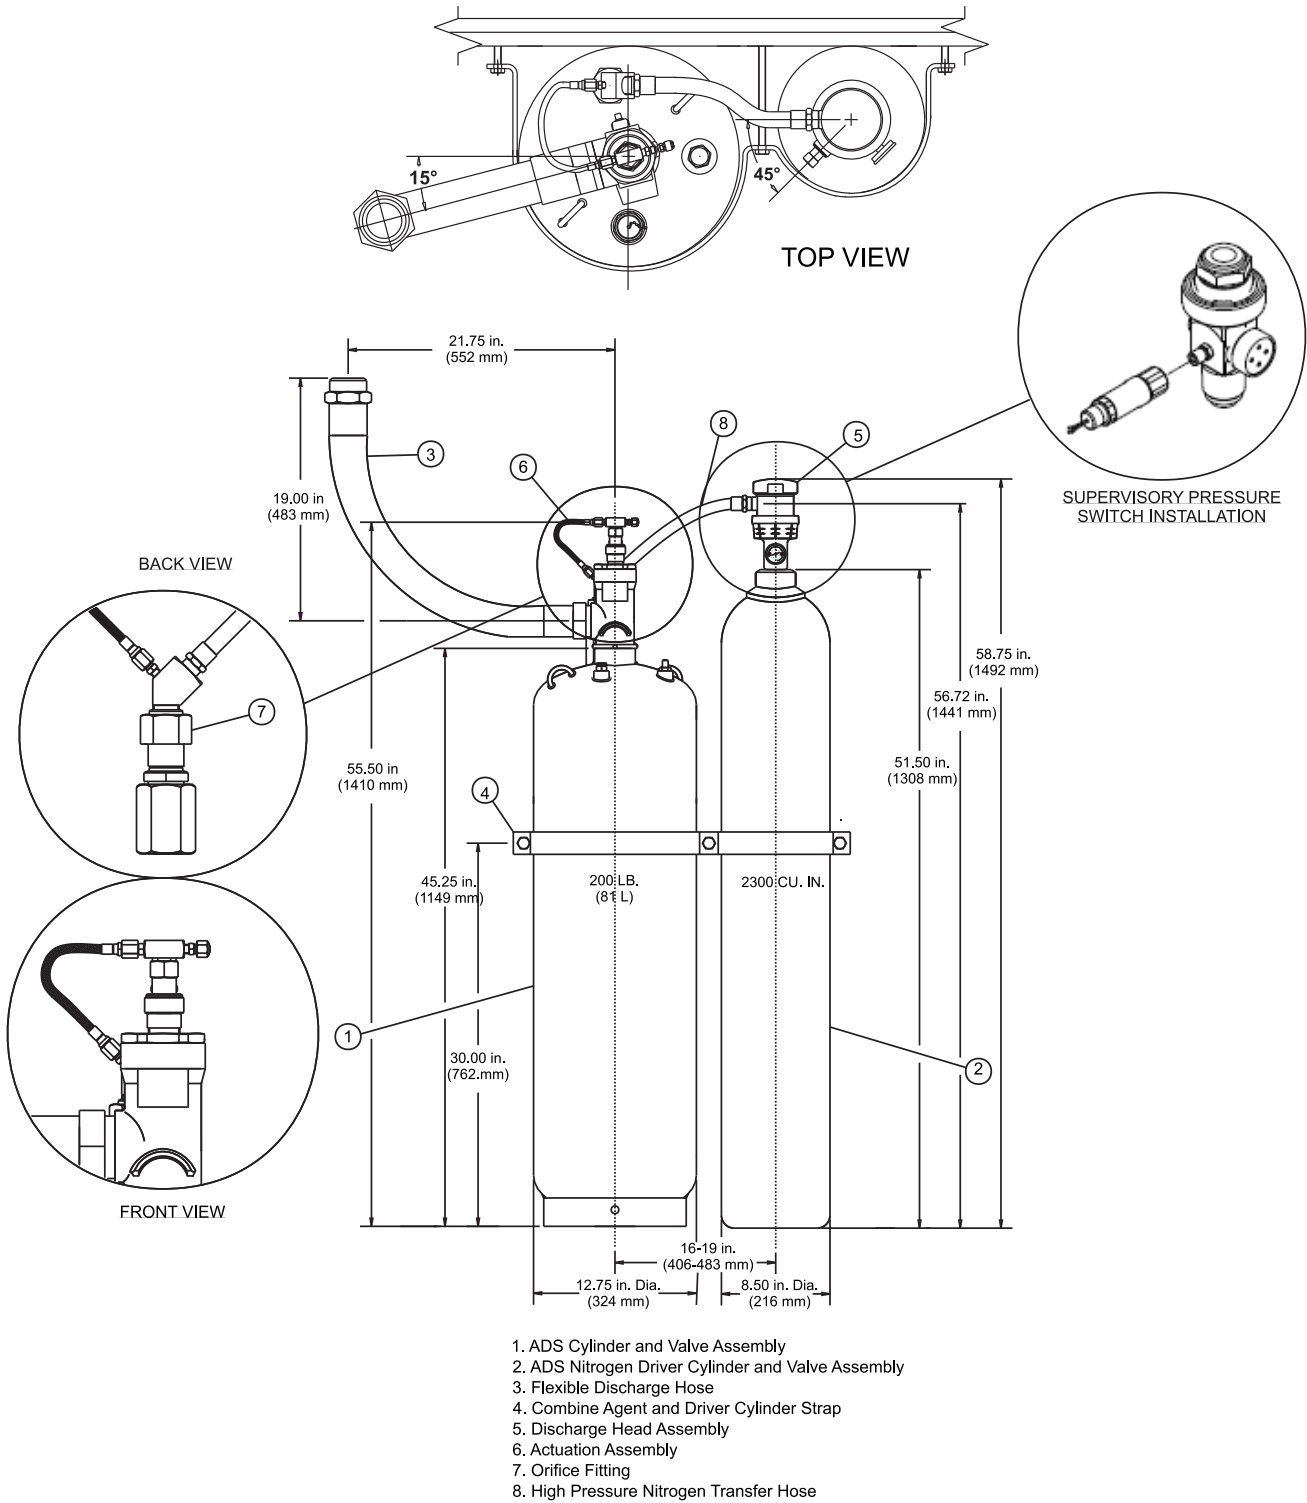


Figure 1. Nitrogen and Agent Cylinders

INSTALLATION

The ADS system installation is based on the requirements of NFPA 2001, *Standard on Clean Agent Extinguishing Systems*, Current Edition.

ASSEMBLY


Both the nitrogen driver and agent storage cylinders are to be installed in the vertical position only. The nitrogen driver is located to the immediate right apart from the agent cylinder (see Figure 1). The nitrogen driver cylinder is connected to the agent cylinder by using the nitrogen transfer components (1-in. nitrogen transfer hose, 3/4-in. NPT transfer fitting, see Figure 2). The 3/4-in. transfer fitting connects into the orifice fitting. The orifice fitting is a custom fitting that is designed to regulate the nitrogen pressure flow required for the specific system. The orifice fitting then connects into the 3/4-in. check diffuser assembly to diffuse the nitrogen in a horizontal pattern.

ACTUATION

The control head is attached to the nitrogen driver by means of electric, cable, lever, or pneumatic devices. The actuating of the agent cylinder is done upon transfer of nitrogen from the driver cylinder using the actuation assembly kit (P/N 06-129882-001).

Assembly includes:

- Nitrogen transfer fitting
- 1/8-in. flex loop
- 1/8-in. flare fitting
- 1/8-in. branch tee
- 1/8-in. Schrader fitting and cap
- Pressure operated control head

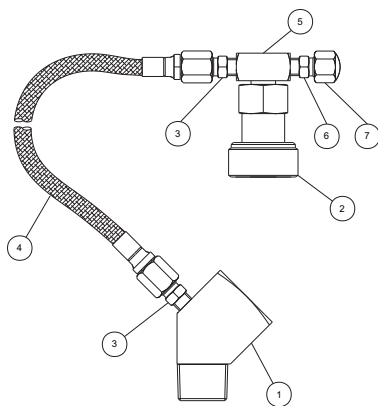

Item	Qty.	P/N	Description
1	1	06-236124-001	Nitrogen Transfer Fitting
2	1	82-878737-000	Pressure Operated Control Head (Pneumatic Actuator)
3	1	06-118191-001	Fitting Flared 1/8-in. x 1/4-in.
4	1	06-118193-001	3/16-in. Flexible Actuation Hose
5	1	06-118192-001	1/8-in. Branch Tee
6	1	WK-263303-000	1/8-in. Schrader Valve
7	1	WK-263304-000	1/8-in. Schrader Valve Cap

Figure 2. Nitrogen Transfer Components

MAINTENANCE

According to NFPA standards, the following inspection and/or maintenance procedure must be scheduled as listed below and performed upon the occurrence of any event, which might affect the reliability of the system. For more information, see the corresponding DIOM manual.

Perform preventive maintenance per the following table:

Schedule	Requirement
Weekly	Check nitrogen cylinder pressure
Monthly	Inspect hazard area system components
Semi-Annually	Test pressure switches
	Test electric control heads
	Check agent cylinder weights
Every 2 Years	Blow out distribution piping
Every 5 Years	Agent and nitrogen cylinder and flexible hose hydrostatic pressure test and/or inspection
Every 15 Years	Rebuild Agent Cylinder Valves

RECONDITIONING

After a system has been discharged, it is recommended that the local authorized Kidde Fire Systems Distributor be contacted to recondition the system. Please reference the corresponding DIOM manual for the appropriate reconditioning kit.

SPECIFICATIONS

Element	Agent Storage Container 45-500201-901		Nitrogen Driver 85-502300-001	
	Imperial	Metric	Imperial	Metric
Fill Range (lb. w/ LLI)	100 to 200 lb.	46 to 91 kg	Factory Filled 1800 PSI	Factory Filled 124 bar
Height	55.50 in.	141.00 cm	55 in.	1397 mm
Diameter	12.75 in.	32.00 cm	8.50 in.	216 mm
Internal Volume	2.859 ft.3	0.0810 m3	2300 cu. in.	0.0377 m3
Empty Weight	133.0 lb.	60.0 kg	102 lb.	46.3 kg
Temperature Range	32°F to 130°F	0°C to 54°C	32°F to 130°F	0°C to 54°C

Note: The Nitrogen used is A-A-59155 Grade A, Type 1.

ORDERING INFORMATION FOR AGENT CYLINDER AND DRIVERS

Part Number	Description
45-500201-901	200 lb. Agent Storage Cylinder
85-502300-001	2300 cu. in. Nitrogen Driver Cylinder
85-111540-001	Supervisory Pressure Switch
85-111540-100	ATEX Supervisory Pressure Switch

MANUALS

Manual	P/N
Kidde Fire Systems ADS™ Fire Suppression System for use with Fluoroketone Fire Suppression Agents Design, Installation, Operation and Maintenance Manual	06-237256-001
Kidde Fire Systems ADS™ Fire Suppression System Marine Series for use with Fluoroketone Fire Suppression Agents Design, Installation, Operation and Maintenance Manual	06-237257-001

EXPORT INFORMATION (USA)

Jurisdiction: EAR
Classification: EAR99

This document contains technical data subject to the EAR.

All trademarks are the property of their respective owners.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. believes this data to be accurate, but it is published and presented without any guarantee or warranty whatsoever. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The fire suppression system design, installation, maintenance, service and troubleshooting must be performed by trained, authorized Kidde Fire Systems distributors for the product to work correctly. If you need more information on this product, or if you have a particular problem or question, contact: KIDDE-FENWAL, INC., Ashland, MA 01721 USA, Telephone: (508) 881-2000.