

Kidde Fire Systems System Component Datasheet




Effective: April 2021
K-85-0513 Rev AE

Nitrogen Pilot Cylinder, Bracket, and Adapter

FEATURES

- UL Listed, ULC Listed, and FM Approved for use with systems listed below in the Table , “Compatibility,” on page 2.

P/N: WK-877940-000

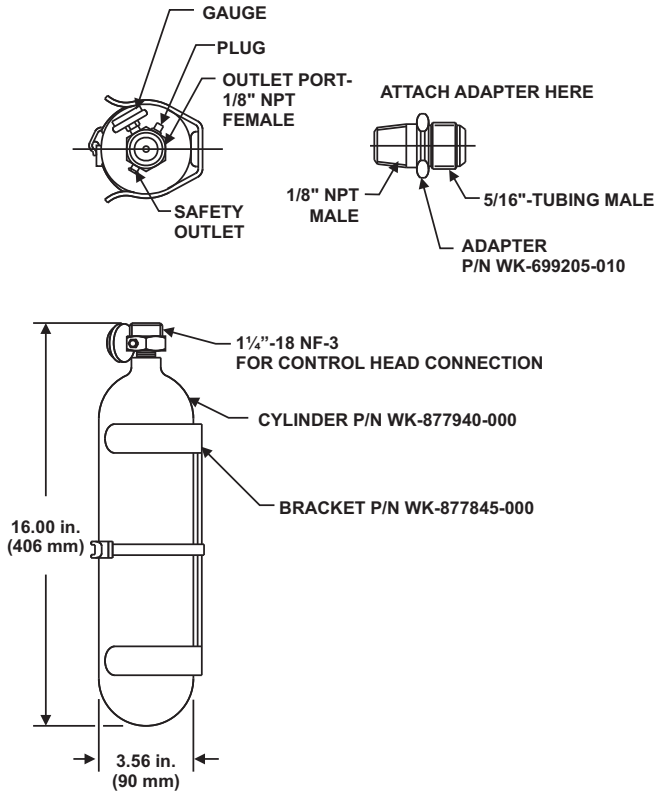

REBUILD KIT

For rebuilding the cylinder and replacing the valve assembly, use kit P/N: 90-990125-000. This kit includes:

Part Number	Description
WK-281309-000	Label - Operating Instructions
WK-293436-000	Gauge – Cyl, Nitrogen Pilot
WK-283428-000	Label – Press Cyl
WK-844393-000	Assy - Valve

MATERIALS

Cylinder: Steel, Painted Black
Valve: Brass
Bracket: Steel, Painted Black
Adapter: Brass

SPECIFICATIONS

- Cylinder Capacity:
108 in.³ (1770 cm³)
- Safety Outlet Burst Range:
2650 to 3000 PSI (183 to 207 bar) at 70°F (21°C)
- Nitrogen:
NITROGEN-BB-n-411b, Grade A, Type 1
1800 PSI (124 bar) at 70°F (21°C)

COMPATIBILITY

Series	DIOM P/N	Approvals
ECS-500™ System	06-237585-001	UL, ULC, FM
ECS-500™ Marine System	06-237589-001	UL, ULC, USCG
ECS™ 360 with 3M™ Novec™ 1230 Fire Protection Fluid	06-236553-001	UL, ULC, FM
ADS™ with 3M™ Novec™ 1230 Fire Protection Fluid	06-237256-001	UL, ULC, FM
ECS™ 360 Marine with 3M™ Novec™ 1230 Fire Protection Fluid	06-236559-001	UL, ULC, USCG
ADS™ Marine with 3M™ Novec™ 1230 Fire Protection Fluid	06-237257-001	UL, ULC, USCG
ECS™ 360 with HFC-227ea Agent	06-236115-001	UL, ULC, FM
Modular ECS™ 360 with HFC-227ea Agent	06-236116-001	UL, ULC, FM
ECS™ 360 Marine with HFC-227ea Agent	06-236225-001	UL, USCG
ADS™ Marine with HFC-227ea Agent	06-236595-001	UL, ULC, USCG
ADS™ with HFC-227ea Agent	06-236068-001	UL, ULC, FM
FE-13™ Engineered Suppression System	06-236169-002	UL
FE-13™ Modular Engineered Suppression System	06-236193-001	UL
High Pressure CO ₂ Marine System	220610	UL, USCG
High Pressure CO ₂	81-CO2MAN-001	UL, ULC, FM
Natura™ Inert Gas System (IGS)	06-237619-001	UL, FM

EXPORT INFORMATION (USA)

Jurisdiction: EAR

Classification: EAR99

This document contains technical data subject to the EAR.

All trademarks are property of their respective owners.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. believes this data to be accurate, but it is published and presented without any guarantee or warranty whatsoever. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. Product features specified are only applicable when the fire suppression system is correctly designed, installed, maintained and serviced by trained, authorized Kidde Fire Systems distributors as per the applicable design, installation, operation, and maintenance manuals. If you need more information on this product, or if you have a particular problem or question, contact: KIDDE-FENWAL, INC., Ashland, MA 01721 USA, Telephone: (508) 881-2000.