

Kidde[®] ECS[™] Fire Suppression System



Designed for use with 3M[™] Novec[™] 1230 Fire Protection Fluid
Cylinder and Valve Assemblies
350 lb. Capacity Cylinder (Marine Applications)


Effective: June 2018
K-45-2650 Rev AA

FEATURES

- UL Listed and USCG Certified for use with Novec 1230 Fire Protection Fluid Systems

P/N: 45-10035X-001


ORDERING INFORMATION

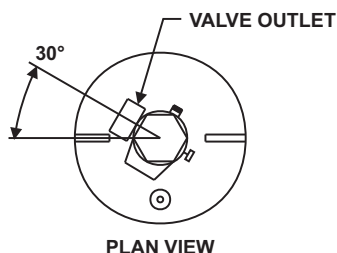

Part Number	Description
45-200351-001	with LLI
45-200350-001	Standard

MATERIALS

- Valve Body: Brass
- Cylinder: Steel, Painted Red

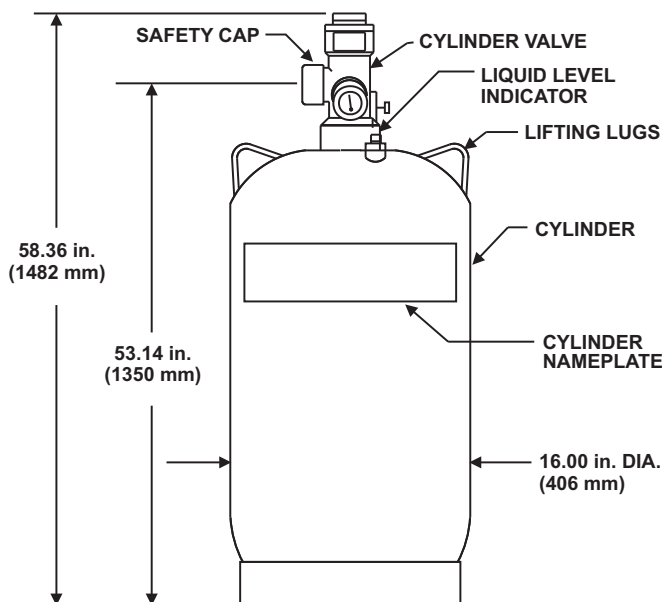

Note:

1. The safety cap must be installed on the valve outlet at all times, except when the cylinders are connected to the system piping, or being filled. The safety cap must not be removed from its chain.
2. See the corresponding Design, Installation, Operation and Maintenance Manual (P/N 06-236559-001) and the datasheet K-45-2670 for additional information.

EXPORT INFORMATION (USA)

Jurisdiction: EAR

Classification: EAR99

This document contains technical data subject to the EAR.

KIDDE is a registered trademarks of Kidde-Fenwal, Inc. or its parents, subsidiaries or affiliates. Novec and 3M are trademarks of the 3M Company.

©2018 Kidde-Fenwal, Inc.

Kidde Fire Systems
400 Main Street
Ashland, MA 01721
Ph: 508.881.2000
Fax: 508.881.8920

www.kiddefiresystems.com

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. believes this data to be accurate, but it is published and presented without any guarantee or warranty whatsoever. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The fire suppression system design, installation, maintenance, service and troubleshooting must be performed by trained, authorized Kidde Fire Systems distributors for the product to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721 USA. Telephone: (508) 881-2000.