

# Kidde Fire Systems Component Description




## Pressure Operated Switch, Explosion Proof

Effective: April 2023  
K-85-5190 Rev AE

### FEATURES

- Listed to: Class I, Groups C and D  
Class II, Groups E, F, and G
- For Approvals, see the "COMPATIBILITY" table on page 2.


P/N 81-981332-000

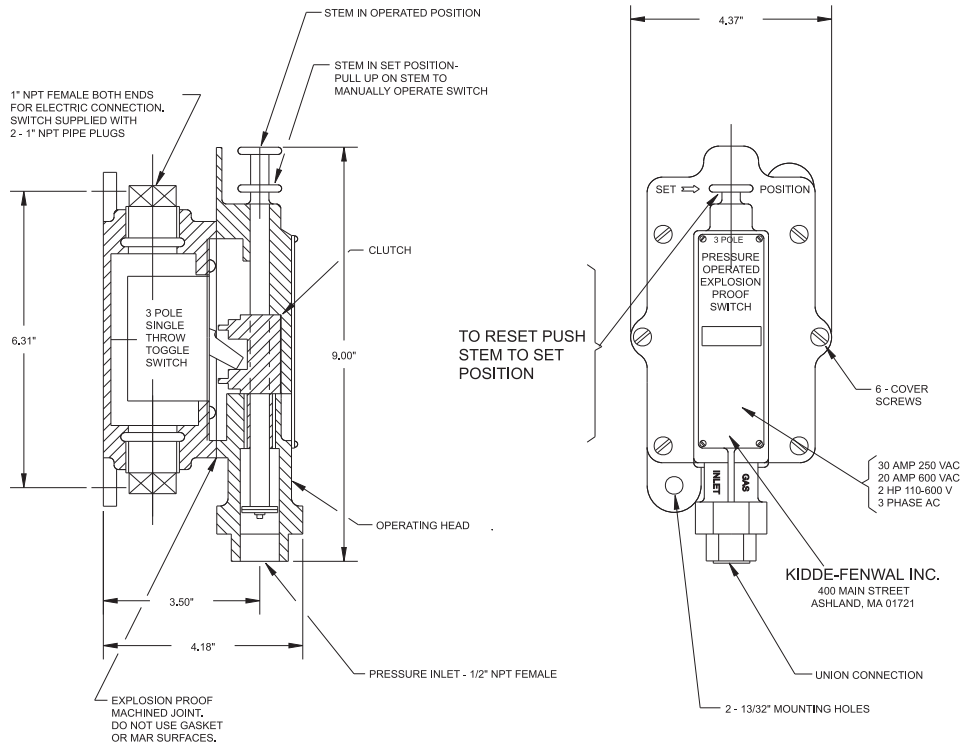

### NOTES

- The toggle switch may be mounted in the base for either N.O. to N.C. or N.C. to N.O. contact transfer upon operation. The illustration above shows the position of the toggle when the switch is in the set position.
- Any load connected to the switch must not exceed the switch rating and shall utilize a suitable protection device (i.e., circuit breaker, fuse).
- Remove the operating head to make electrical connections to the toggle switch. When replacing the operating head, ensure that the toggle engages the clutch. Tighten the cover screws securely.
- Class I, Group D Caution: To prevent ignition of hazardous atmospheres, disconnect the device from the supply circuit before opening. Keep the assembly tightly close when in operation.
- Installation and conduiting should comply with NEC (NFPA 70) standards for hazardous locations.
- The explosion-proof pressure switch is not waterproof or rated for outdoor applications and must be mounted either indoors or in an enclosure that is protected from water.

 <b>WARNING</b>	<p><b>To prevent ignition of hazardous atmospheres, disconnect the device from the supply circuit before opening. Keep the assembly tightly closed when in operation.</b></p>
---	---

 <b>WARNING</b>	<p><b>Do not scratch or mar the surface of the explosion proof machined joint. Doing so may create a flame path and lead to an explosion.</b></p>
---	---

## COMPATIBILITY

Series	DIOM P/N	Approvals
Kidde Fire Systems ECS-500™ System	06-237585-001	UL, ULC, FM
Kidde Fire Systems ECS-500™ Marine System	06-237589-001	UL, ULC, USCG
Kidde Fire Systems ADS™ for use with Fluoroketone Fire Suppression Agents	06-237256-001	UL, ULC, FM
Kidde Fire Systems ADS™ Marine for use with Fluoroketone Fire Suppression Agents	06-237257-001	UL, ULC, USCG
Kidde Fire Systems ADS™ with HFC-227ea Agent	06-236068-001	UL, ULC, FM
Kidde Fire Systems ADS™ Marine with HFC-227ea Agent	06-236595-001	UL, ULC, USCG
Kidde Fire Systems ECS™ 360 for use with Fluoroketone Fire Suppression Agents	06-236553-001	UL, ULC, FM
Kidde Fire Systems ECS™ 360 Marine for use with Fluoroketone Fire Suppression Agents	06-236559-001	UL, ULC, USCG
Kidde Fire Systems ECS™ 360 with HFC-227ea Agent	06-236115-001	UL, ULC, FM
Kidde Fire Systems Modular ECS™ 360 with HFC-227ea Agent	06-236116-001	UL, ULC, FM
Kidde Fire Systems ECS™ 360 Marine with HFC-227ea Agent	06-236225-001	UL, USCG

### EXPORT INFORMATION (USA)

Jurisdiction: EAR  
Classification: EAR99

This document contains technical data subject to the EAR.

All trademarks are the property of their respective owners.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. believes this data to be accurate, but it is published and presented without any guarantee or warranty whatsoever. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The fire suppression system design, installation, maintenance, service and troubleshooting must be performed by trained, authorized Kidde Fire Systems distributors for the product to work correctly. If you need more information on this product, or if you have a particular problem or question, contact: KIDDE-FENWAL, INC., Ashland, MA 01721 USA, Telephone: (508) 881-2000.